


1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70

- 1# low-voltage protection
- 1# high voltage protection
- 1# Machine protection
- 1# Level of protection
- 1# Differential protection
- 1# Fan protection
- 2# Fan protection
- 3# Fan protection
- 4# Fan protection
- 5# Fan protection
- 6# Fan protection
- External switch
- Flow switch
- External linkage
- 2# low-voltage protection
- 2# high voltage protection
- 2# Machine protection
- 2# Level of protection
- 2# Differential protection
- 7# Fan protection
- 8# Fan protection
- 9# Fan protection
- 10# Fan protection
- 11# Fan protection
- 12# Fan protection
- Emergency stop switch
- 1# Heater
- 1# Hydraulic valve
- 25 Electromagnetic valve
- 25 Electromagnetic valve
- 1# Electromagnetic valve
- 1# Electromagnetic valve
- 1# Economizer valve
- 1# Motor spray valve
- 1# Oil cooling electromagnetic valve
- 1# Machine protection power supply
- 2# Heater
- 2# Hydraulic valve
- 2# Electromagnetic valve
- 2# Electromagnetic valve
- 2# Economizer valve
- 2# Motor spray valve
- 2# Oil cooling electromagnetic valve
- 2# Machine protection power supply
- 2# Machine protection power supply
- Fault light

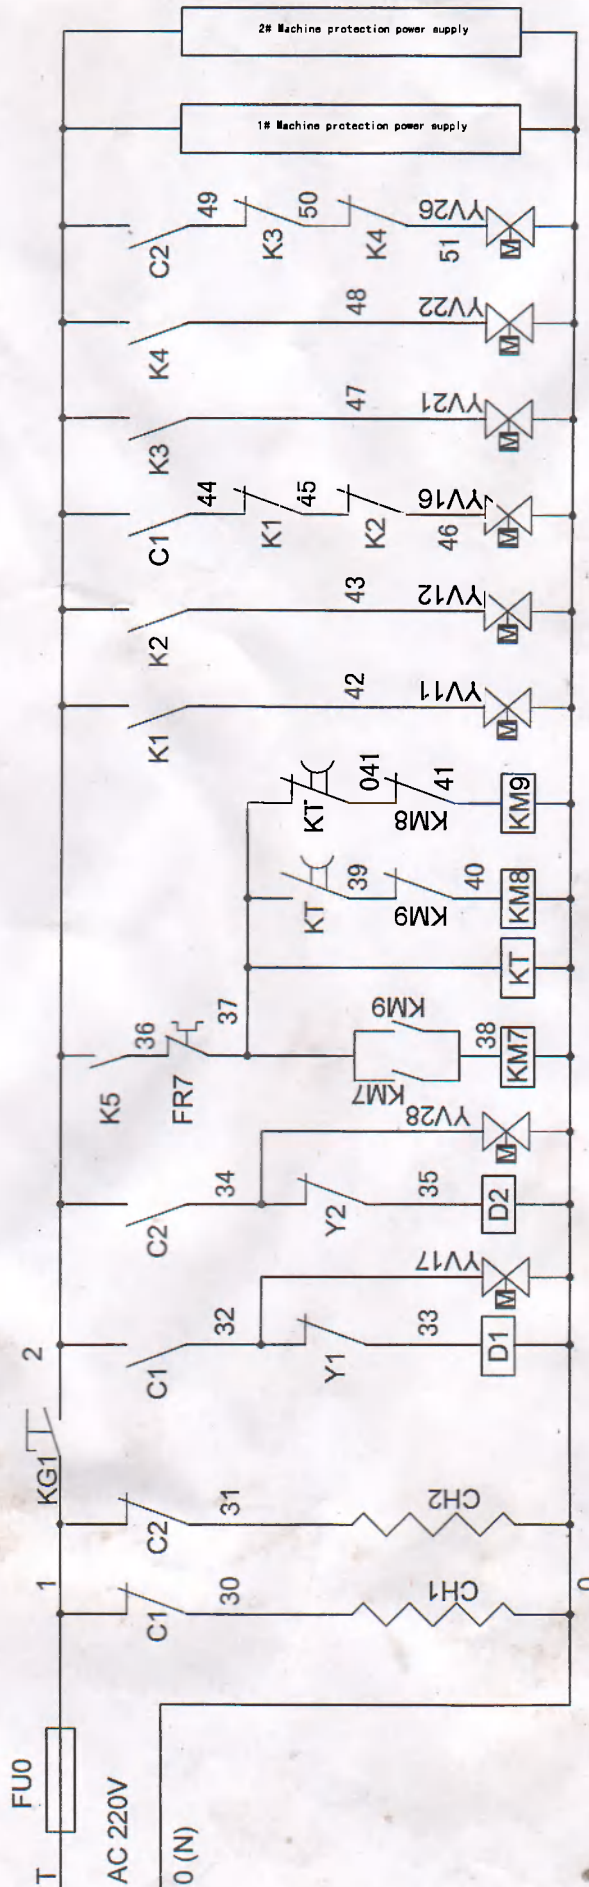

Note: the diagram dotted part customer self-care

Change record	Date	Mark	Design	Audit	Name	
		Proofing	Huangyanxiu	Luoyuexie	Air cooled chillers	
			Wendaofu	approval	STARS (GUANGZHOU) REFRIGERATING EQUIPMENT MANUFACTURING CO., LTD	
				Date	40STE-S310ADDL3(2-2)	
					number	

